


Application Note

How to interface the MDM-1-DEV to the MPLAB-ICD Module

The MDM-1 and the ICD header module both use the same device; the PIC16F877. This means that the MDM-DEV 1 can be run directly from the MPLAB-ICD system. The interface connection is as follows:-

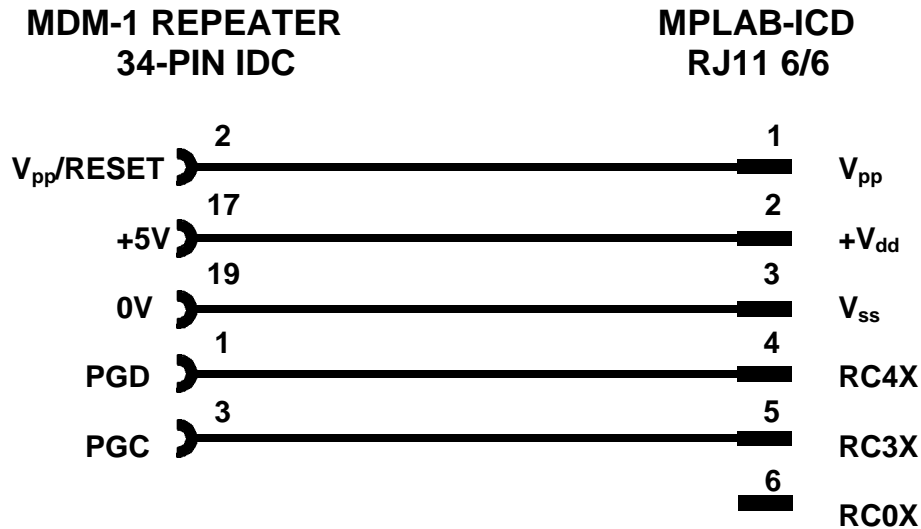

Please note that the module should have the Low Voltage Programming disabled in the configuration word and RC0X must not be connected.

See Microchip Technical Note number 20 and 21 available for download at:-

<http://www.microchip.com/download/tools/picmicro/icds/mplabidc/etn20.pdf>

<http://www.microchip.com/download/tools/picmicro/icds/mplabidc/etn21d.pdf>